



Exam Code: HP0-S13

Exam Name: HP BladeSystems c-Class Solutions 1

Vendor: HP

Version: DEMO

Part: A

1: You are configuring the MSA1000 storage solution to boot from a SAN. Although there are several physical drives reported in the ACU graphical user interface, the Selective Storage Presentation (SSP) link is missing.


Why?

- A.The ACU has detected multiple paths from the host.
- B.The MSA1000 does not have any logical drives defined.
- C.An incorrect MSA1000 device driver is loaded in the host server.
- D.The host server is not running the HP Insight Agents, or these agents are outdated.

Correct Answers: B

2: Click the Exhibit button.

In a four-fan configuration, where must these fans be installed?

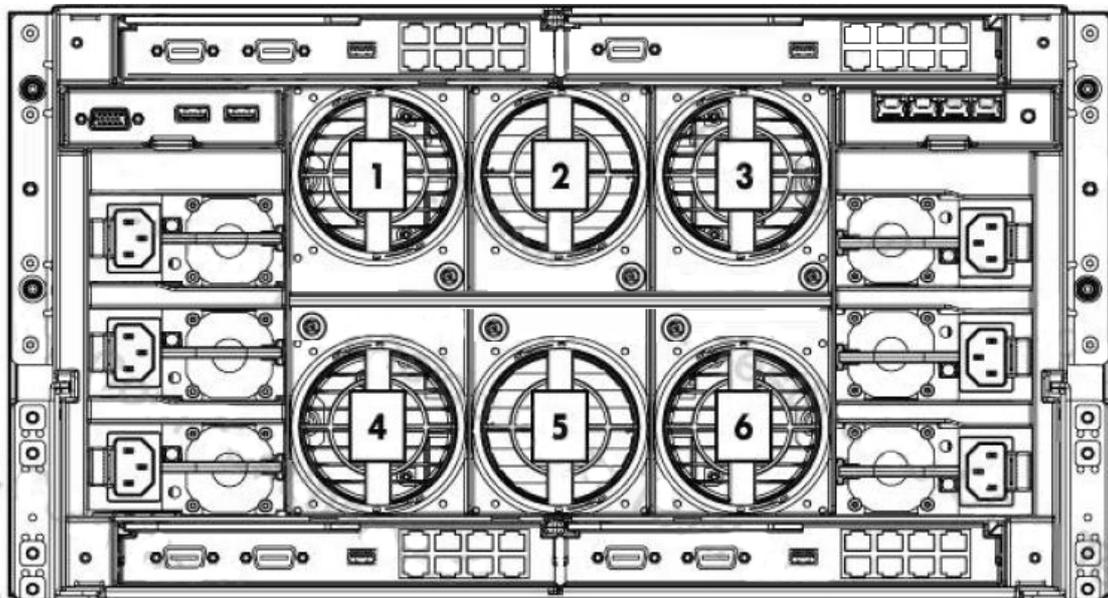

- A.bays 1, 2, 3, and 4
- B.bays 1, 2, 3, and 5
- C.bays 2, 4, 5, and 6
- D.bays 3, 4, 5, and 6

Correct Answers: C

3: Which statements are true regarding the HP StorageWorks Ultrium 448c Tape Blade? (Select three.)

- A.The tape blade provides direct-attach data protection for the adjacent server blade.
- B.The tape blade provides network backup protection for all data within the enclosure.
- C.The tape blade installs in a full-height device bay of either the c3000 or c7000 enclosure.
- D.The tape blade installs in a half-height device bay of either the c3000 or c7000 enclosure.
- E.The tape blade and the SB40c storage blade can both partner with the same full-height server blade.
- F.The tape blade can partner with any of the HP BladeSystem c-Class ProLiant or Integrity server

blades.

Correct Answers: A B D

4: Which role-based Virtual Connect Manager access enables you to create, edit, and delete Virtual Connect profiles?

- A.Server
- B.Admin
- C.Storage
- D.Domain
- E.Networking

Correct Answers: A

5: How will the HP BladeSystem c-Class enclosures indicate if a server blade is not installed in the correct device bay?

- A.The HP BladeSystem Insight Display will flash blue.
- B.The interconnect will display errors when you configure it.
- C.The Onboard Administrator will not allow the enclosure to power on.
- D.The Onboard Administrator will not allow the interconnects to power on.
- E.The Onboard Administrator will not allow the incorrectly placed server blade to power on.

Correct Answers: E

6: Ten fans are installed in a fully populated c7000 enclosure and are configured as AC Redundant. All server blades are powered on. What happens if one fan fails? (Select three.)

- A.The fan subsystem health status remains OK.
- B.The health LED of the failed fan illuminates red.
- C.The health LED of the failed fan illuminates solid amber.
- D.The fan subsystem health status changes to FAILED.
- E.The fan subsystem health status changes to DEGRADED.
- F.The Onboard Administrator increases the fan RPM to maximum.
- G.The Onboard Administrator begins to shut down the least active server blades.

Correct Answers: C E F

7: To utilize all four Ethernet ports on the NC325m PCIe Quad-Port 1Gb Server Adapter, which mezzanine position must you avoid?

- A.mezzanine position 1 in full-height server blades
- B.mezzanine position 2 in full-height server blades
- C.mezzanine position 3 in full-height server blades
- D.mezzanine position 1 in half-height server blades
- E.mezzanine position 2 in half-height server blades

Correct Answers: D

8: Which statements are true regarding the BladeSystem? (Select two.)

- A.BladeSystem c-Class and p-Class server blades will not ship until 2009.
- B.The c-Class interconnects are compatible with the p-Class interconnects at a management

interface level.

C.c-Class server blades can be installed in a p-Class enclosure with an enclosure upgrade kit.

D.p-Class and c-Class server blades are compatible with industry-standard Web Based Enterprise Management (WBEM).

E.The Onboard Administrator can manage both p-Class and c-Class enclosures.

Correct Answers: B D

9: Which types of drives are supported by the HP BladeSystem c-Class storage blades? (Select two.)

A.SCSI

B.Serial ATA (SATA)

C.Parallel ATA (PATA)

D.Serial Attached SCSI (SAS)

E.Fibre Attached Technology Adapted (FATA)

Correct Answers: B D

10: Which statements are true when using the HP StorageWorks SB40c storage blade for c-Class? (Select three.)

A.Each SB40c storage blade can partner with only one server blade.

B.A c7000 enclosure can have a maximum of eight SB40c storage blades.

C.The SB40c storage blade supports Serial Attached SCSI (SAS) drives only.

D.A full-height storage blade can connect to a maximum of two SB40c storage blades.

E.Each SB40c storage blade requires an HP PCI Express Mezzanine Pass-Thru card to be installed in mezzanine slot 3 of the full-height storage blade.

F.If connecting both the SB40c storage blade and the Ultrium 448c tape blade to the same full-height server blade, the SB40c storage blade must be installed in the top bay.

Correct Answers: A B E